


46

MUNICIPAL CORPORATION OF DELHI
PUBLIC HEALTH DEPARTMENT, CENTRAL ZONE
SHIV MANDIR MARG, LAJPAT NAGAR, NEW DELHI



No.DHO/CNZ/2024/ 1736

Dated: 15/01/2024

SCHOOL HEALTH CERTIFICATE

Name of the school: **Dev Samaj Modern School No-2.**

Address of School: Okhla (Sukhdev Vihar), New Delhi-110025

Shifts: ONE Timing: MORNING

No. of Students: Boys: 1155 Girls: 1195 Total: 2350

No. of Staff (Teachers): Female: 83 Male: 17 Total: 100


That the accommodation provided for the class rooms as calculated.

1. (A) On floor space is sufficient Yes
- (B) On Cubic space is sufficient Yes
2. That the classrooms are well ventilated Yes
3. That the classrooms are kept neat and clean Yes
4. That the classrooms are well lighted Yes

That the building is not in substantial repair in the class of NIL

5. That the drinking water is wholesome Wholesome
6. That the latrines arrangement is adequate and there are sufficient latrines.
7. That urinals arrangement is adequate and there are sufficient urinals

This certificate is issued for sanitary and hygienic condition from health point of view of the school premises. This certificate has no bearing structure stability and fire safety. This certificate is valid for one year from the date of issue.

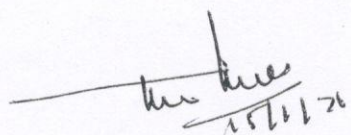

Dy. Health Officer
Central Zone


Deputy Health Officer
Central Zone, MCD

"STOP CORONA VIRUS-Wash Your Hand/Wear Mask/Maintain Social Distance"

DELHI JAL BOARD
(GOVT. OF N.C.T. DELHI)
QUALITY CONTROL ZONAL LABORATORY (SOUTH)
WATER WORKS OKHLA DELHI-110025



Licence No- CRO/QM/L-8004290 IS/ISO 9001:2015



Ref. A.C.W.A.(South)/Paid/2022-23/P27-28/C/hallan no 79 dt 30.05.22

S. No 8015

Date: 15.06.22

M/S DEV SAMAJ MODERN SCHOOL NO 2
OKHLA (SUKHDEV VIHAR)
NEW DELHI - 110025

S.N	Characteristics	Unit	Acceptable Limit	Permissible Limit	Test Method	TAP KITCHEN G.F.	DRINKING POINT BACKSIDE OF CLASS XI A
Table 1: Physical Examination							
1.	Clarity	Unit	5	15	IS 3025 Part-4	Clear	Clear
2.	Odour	---	Agreeable	Agreeable	IS 3025 Part-5	No. Obj.	No. Obj.
3.	Turbidity	NTU	1	5	IS 3025 Part-10	1.92	2.17
4.	pH Value	---	6.5-8.5	No relaxation	IS 3025 Part-11	7.7	7.7
5.	Conductivity	µmho/cm ²	---	---	---	311	311
6.	Total Dissolved Solids	mg/L	500	2000	IS 3025 Part-16	202	202
Table 2: CHEMICAL EXAMINATION							
1.	Phenolphthalein Alkalinity	mg/L	---	---	---	NIL	NIL
2.	Total Alkalinity (as CaCO ₃)	mg/L	200	600	IS 3025 Part-23	94	96
3.	Total Hardness (as CaCO ₃)	mg/L	200	600	IS 3025 Part-21	120	124
4.	Carbonate hardness	mg/L	---	---	---	94	96
5.	Non- Carbonate Hardness	mg/L	---	---	---	26	28
6.	Calcium Hardness	mg/L	---	---	---	86	82
7.	Magnesium Hardness	mg/L	---	---	---	34	42
8.	Ammonia (as Total N)	mg/L	0.5	No relaxation	IS 3025 Part-34	ND	ND
9.	Nitrite (as N)	mg/L	---	---	---	ND	ND
10.	Nitrate	Mg/L	---	45.0	IS 3025 Part-34	4.35	4.6
11.	Sulphate (as SO ₄)	mg/L	200	400	IS 3025 Part-24	34	33
12.	Chloride (as Cl)	mg/L	250	1000	IS 3025 Part-40	24	26
13.	Iron	Mg/l	---	1.0	IS 3025 Part-53	0.06	0.4
14.	Fluoride	mg/L	1.0	1.5	IS 3025 Part-60	0.4	32.8
15.	Calcium (as Ca)	mg/L	75	200	IS 3025 Part-57	34.4	10.08
16.	Magnesium (as Mg)	mg/L	30	100	IS 3025 Part-46	8.16	0.56
17.	Free Residual Chlorine	mg/L	0.2	1	IS 3025 Part-26	0.62	

REMARKS :- AS PER BIS-10500:2012 On the basis of tested parameters the both sample result are within permissible limit. Subject to Bacteriological analysis result.

Assistant Chief Water Analyst
Delhi Jal Board (A Govt. of Delhi)
Zonal Laboratory (South)
W.W. Okhla New Delhi - 110 025
ACWA(SOUTH)

CHEMIST

ACHEMIST

Copy to:-
1 CWA(W&S)-III
2 Office Copy